

DETAIL SPECIFICATION SHEET

FUSE BOXES, FEEDER DISTRIBUTION, TOTALLY ENCLOSED,
450 VOLTS, ALTERNATING CURRENT, THREE PHASE BUSES,
SINGLE AND THREE PHASE BRANCHES, 0-30 AND 31-60 AMPERE FUSES,
SYMBOLS 543, 544, 545, 546 AND 547

This amendment forms a part of MIL-DTL-24646/4A, dated 17 May 2002, and is approved for use by all Departments and Agencies of the Department of Defense.


The attached insertable replacement pages listed below are replacements for stipulated pages. When the new pages have been entered in the document, insert the amendment as the cover sheet to the specification.

<u>Replacement page</u>	<u>Page replaced</u>
5	5
6	Reprinted without change


Custodians:
Navy - SH
DLA - CC

Preparing activity:
DLA - CC
(Project 5920-0765)


MIL-DTL-24646/4A
AMENDMENT 1

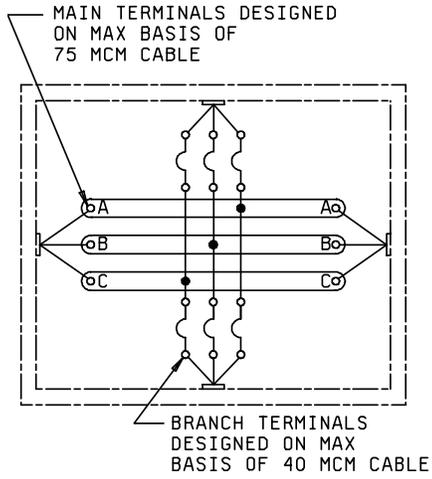


A. Two 3-phase branches
(Symbol 543)

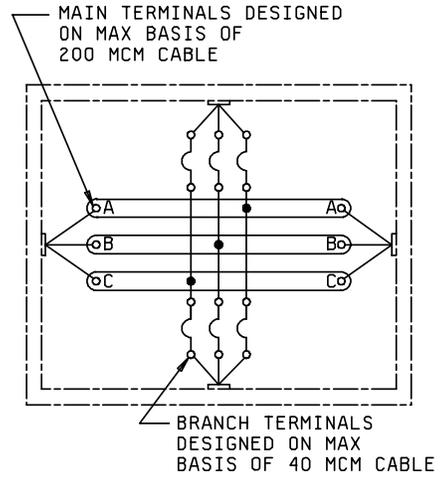

B. Two 3-phase branches
(Symbol 546)

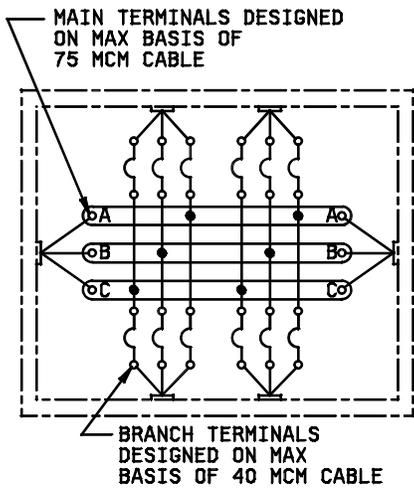

C. Four 3-phase branches
(Symbol 544)

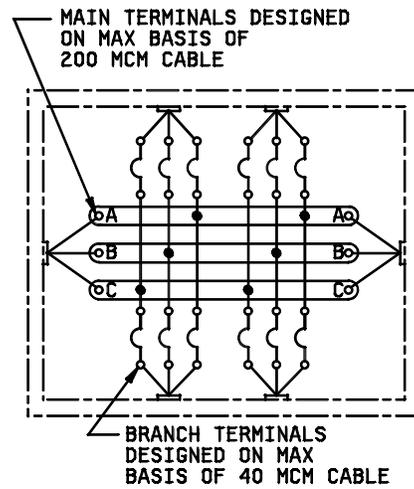


D. Four 3-phase branches
(Symbol 547)


FIGURE 5. Wiring diagrams. Item No. 16, 17, 18, 19, 20

Supersedes page 5 of MIL-DTL-24646/4A of 17 May 2002.

MIL-DTL-24646/4A
AMENDMENT 1

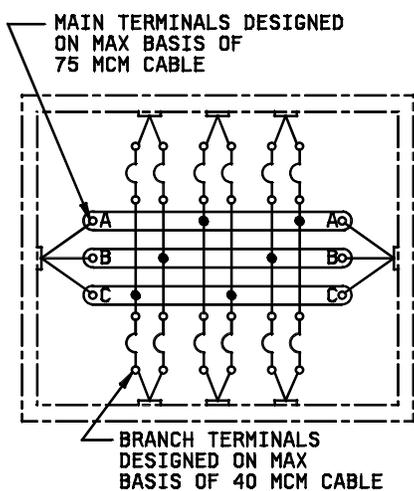

E. Six single-phase branches
(Symbol 544)

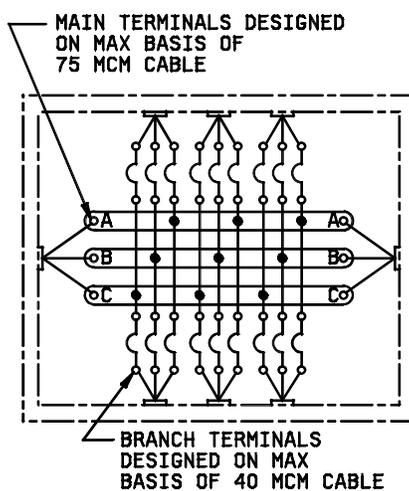

F. Six 3-phase branches
(Symbol 545)

FIGURE 5. Wiring diagrams. Item No. 16, 17, 18, 19, 20 - Continued.

Reprinted without change.