

INCH-POUND

MIL-PRF-15160/19D

4 May 2001

SUPERSEDING

MIL-PRF-15160/19C

12 October 1999

PERFORMANCE SPECIFICATION SHEET

FUSES, INSTRUMENT, POWER, AND TELEPHONE  
(NONINDICATING), STYLE F19

This specification is approved for use by all Departments and Agencies of the Department of Defense.

The requirements for acquiring the product described herein shall consist of this specification and MIL-PRF-15160.

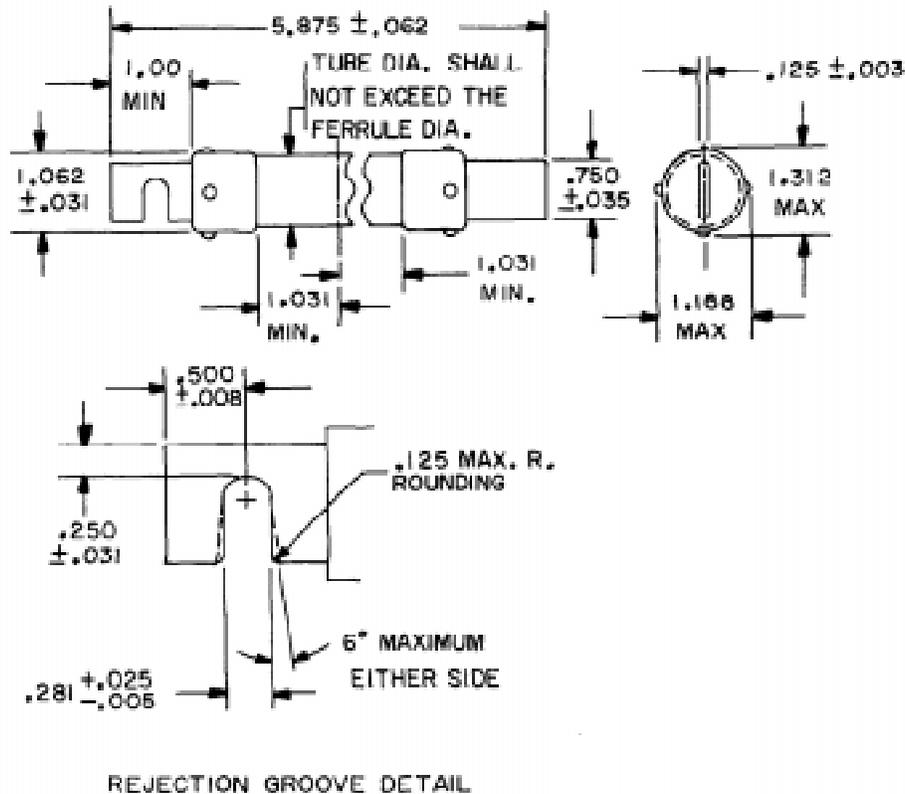


FIGURE 1. Style F19, characteristic BR.

MIL-PRF-15160/19D

Inches	mm	Inches	mm
0.003	0.08	0.281	7.14
0.005	0.13	0.500	12.70
0.008	0.20	0.750	19.05
0.025	0.64	1.000	25.40
0.031	0.79	1.031	26.19
0.035	0.89	1.062	26.97
0.062	1.57	1.188	30.16
0.125	3.18	1.312	33.32
0.250	6.35	5.875	149.23

NOTES:

1. Dimensions are in inches.

FIGURE 1. Style F19, characteristic BR - continued.

REQUIREMENTS:

Interface and physical dimensions: See figure 1.

Case: Fiber or alternate material.

(Alternate to fiber material (tube) shall have an average burst strength of 1,900 pounds per square inch with a value of not less than 1,400 pounds per square inch).

Knifeblade: Copper.

Finish: Nickel, bright alloy, or bright dipped, silver plated when specified.

Terminal strength: Method 211 of MIL-STD-202, test condition E, 5 inch-pound torque between ferrules and fuse body.

Electrical:

Electrical requirements shall be as specified in table I.

Shock: Method 207 of MIL-STD-202, HI shock.

Vibration: Method 204 of MIL-STD-202, test condition A (except 5g peak).

TABLE I Electrical requirements.

Characteristics	BR
Voltage rating	250 V ac 250 V dc
Overload test <u>1/</u> 135% 500%	0 – 2 hour 10 – 25 seconds
Short circuit test at 250 V dc at 250 V ac	10,000A 200,000A (20% PF max.) <u>2/</u>

1/ Overload is shown as a percentage of the current rating of the fuse.

2/ Power factor (PF).

Type designation: Type designation shall be as specified in table II.

TABLE II Type designations and electrical rating. 1/ 2/

Style	Characteristic	Maximum voltage	Current rating
F19	BR <u>3/</u>	250V	70A
F19	BR <u>3/</u>	250V	80A
F19	BR <u>3/</u>	250V	90A
F19	BR <u>3/</u>	250V	100A

1/ For silver plated terminals, the designator "S" is added after the current rating.

2/ The characteristic A fuse has been discontinued without replacement.

3/ The characteristic B fuse has been discontinued. The characteristic BR fuse may be used to replace the old characteristic B fuse of the same current rating.

VERIFICATION:

Qualification inspections: The number of qualification samples required shall be:

- a. 24 samples maximum current rating of each voltage and design.
- b. 24 samples minimum current rating of each voltage and design.

NOTE: If labels are used, five additional samples of any rating are required.

Marginal notations are not used in this revision to identify changes with respect to the previous issue due to the extent of the changes.

MIL-PRF-15160/19D

Custodians:

Army - CR  
Navy - SH  
Air Force - 11  
DLA - CC

Preparing activity:

DLA - CC

(Project 5920-0717)

Review activities:

Army - AR, AT, CR4, MI  
Navy - AS, CG, MC, OS  
Air Force - 19, 99