


MILITARY SPECIFICATION SHEET

Ⓐ RECEPTACLE, PLUG, ELECTRICAL, 4-POLE GROUNDED, 60-AMPERE,  
450-VOLT, 3-PHASE (SYMBOL NO. 1261)

Ⓐ This specification is approved for use within the Naval Sea Systems Command, Department of the Navy, and is available for use by all Departments and Agencies of the Department of Defense.

Ⓐ The requirements for acquiring the receptacle described herein shall consist of this specification and the latest issue of MIL-R-2726.

Ⓐ denotes changes.

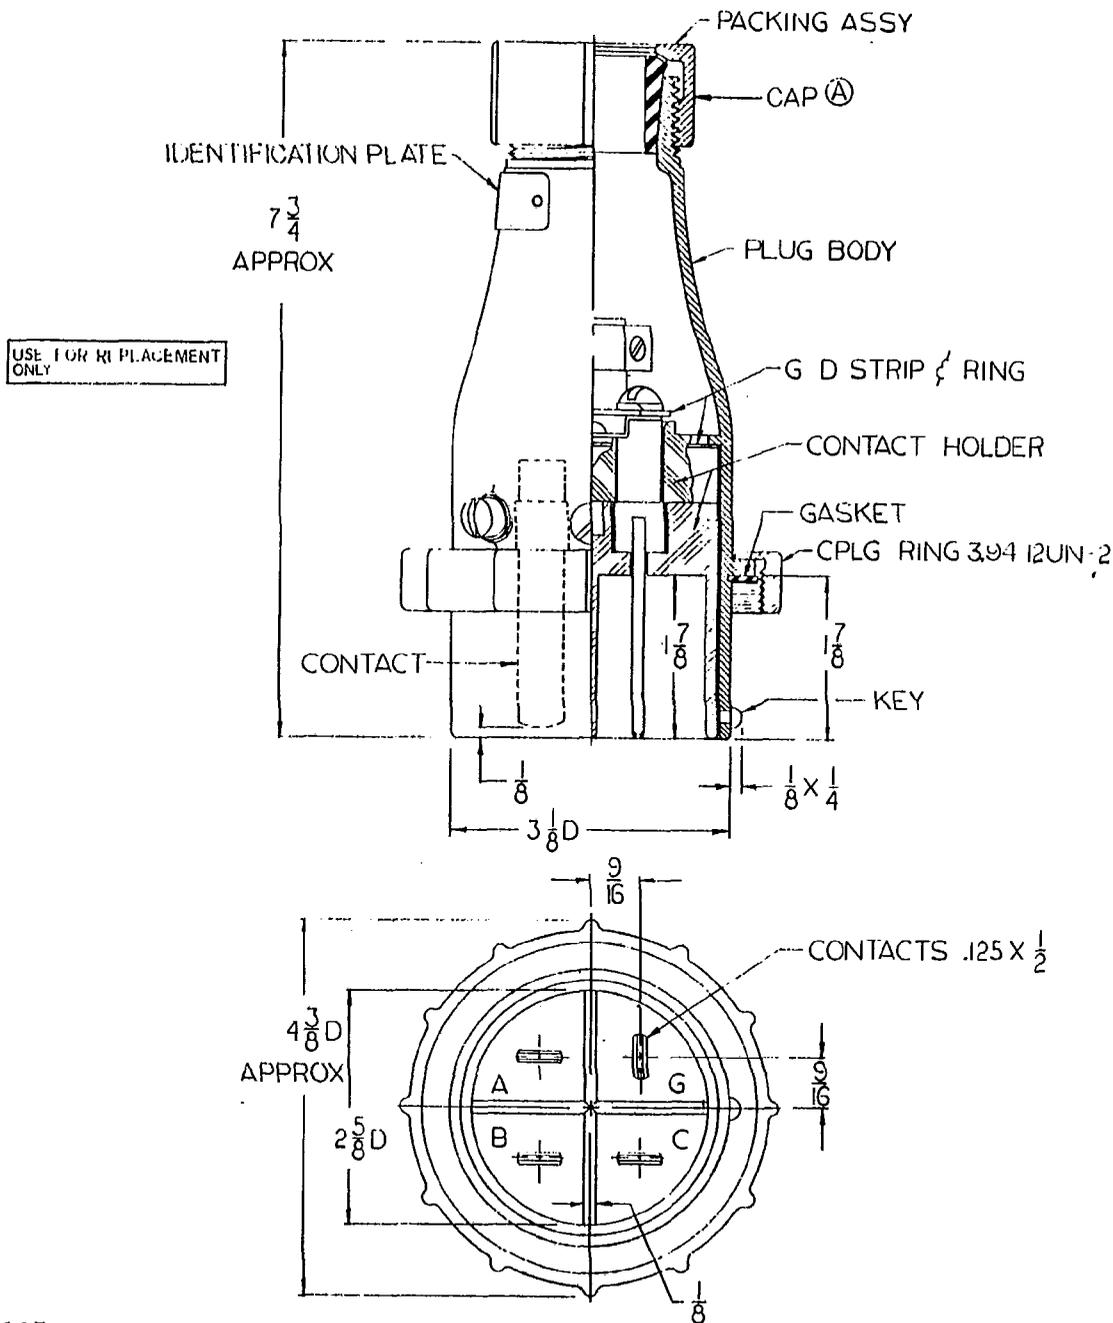

SH 9137

**NOTE:**

1. Dimensions are in inches. Unless otherwise specified, tolerances are  $\pm 1/64$  inch for fractions.

**FIGURE 1. Dimensions and configuration.**

## REQUIREMENTS:

1. Dimensions and configuration: See figure 1.
2. Effectiveness of enclosure: Watertight in accordance with MIL-STD-108 when coupled with mating receptacle.
3. Strain relief: 40 pounds.
4. Contact resistance: 75 millivolts measured between the ends of two 24-inch lengths of test cable properly connected to a test receptacle and the plug, respectively.
5. Material: Plug body - optional.  
Contact holder - in accordance with type MAI-60 of MIL-M-14.
6. Contact hardness: Minimum of Rockwell 45B.
7. Mating receptacle: MIL-R-2726/61, part number M2726/61-001 (not furnished).
8. Test cable: Commercial, 4 conductor, AWG size 4 (259 by 25) 600-volt, type W (not furnished).
9. Design: Enclosed terminal barriers shall be provided.
10. Part number: M2726/56-001.
11. Electrical rating: 60-ampere, 450-volt, alternating current, 60-hertz.
12. Cap: MIL-S-19622/10, part number M19622/10-0003 to be furnished.
13. Packing assembly: MIL-S-19622/18, part number M19622/18-018 (not furnished).

(A) QUALITY ASSURANCE:

Quality assurance shall be as specified in MIL-R-2726 and table I herein. The first article and quality conformance inspections shall consist of the inspections as specified in table I, in the order shown.

TABLE I. First article and quality conformance inspection.

Inspection	Requirement	Test method	First article	Quality conformance
Examination	3.1, 3.3, 3.4, 3.5, 3.6 and 3.7	4.6.1	X	X
Insulation resistance	3.5.1	4.7.1	X	X
Dielectric withstanding voltage	3.5.2	4.7.2	X	X
Contact resistance	3.5.3.1	4.7.3.1	X	X
Endurance	3.5.5	4.7.5	X	
Salt spray	3.5.11	4.7.11	X	
Contact resistance	3.5.3.1	4.7.3.1	X	
Current load	3.5.12	4.7.12	X	
Vibration	3.5.9	4.7.9	X	
Shock	3.5.10	4.7.10	X	
Effectiveness of enclosure	3.5.4	4.7.4	X	X
Dielectric withstanding voltage	3.5.2	4.7.2	X	
Mechanical abuse	3.5.8	4.7.8	X	
Ball drop impact	3.5.15	4.7.15	X	
Strain relief	3.5.7	4.7.7	X	
Rockwell hardness	3.5.14	4.7.14	X	

Preparing activity:  
Navy - SH  
(Project 5935-N255-57)