

FEDERAL SPECIFICATION SHEET

CONNECTOR, RECEPTACLE, ELECTRICAL, GENERAL PURPOSE, DUPLEX,
 GROUNDING, HOSPITAL GRADE, GROUND FAULT CIRCUIT INTERRUPTING,
 2 POLE, 3 WIRE, 15 AMPERES, 125 VOLTS, 60 HERTZ

The General Services Administration has authorized the use
 of this federal specification sheet by all federal agencies.

The complete requirements for procuring the connectors described herein shall
 consist of this document and the latest issue of W-C-596/GEN.

NOTES:

1. For mounting dimensions see W-C-596/GEN, configuration B (duplex receptacles with break-off ears).
2. Dimensions are in inches.
3. Metric equivalents are given for general information only.
4. Orientation of receptacle faces and location of test and/or reset buttons optional.
5. The GFCI shall be furnished with a wallplate of the appropriate color.
6. If an indicator light is provided, when lighted it shall indicate power availability to the receptacle; when unlighted it shall show the "tripped" condition of the circuit interrupter.
7. If wire leads are provided in lieu of other termination means, the green (ground) leads shall be a minimum of 6 inches long and the remaining leads shall be a minimum of 4 inches long. Each wire shall be capable of withstanding pull of 20 pounds for one minute.
8. Undimensioned pictorials are for reference purposes only.

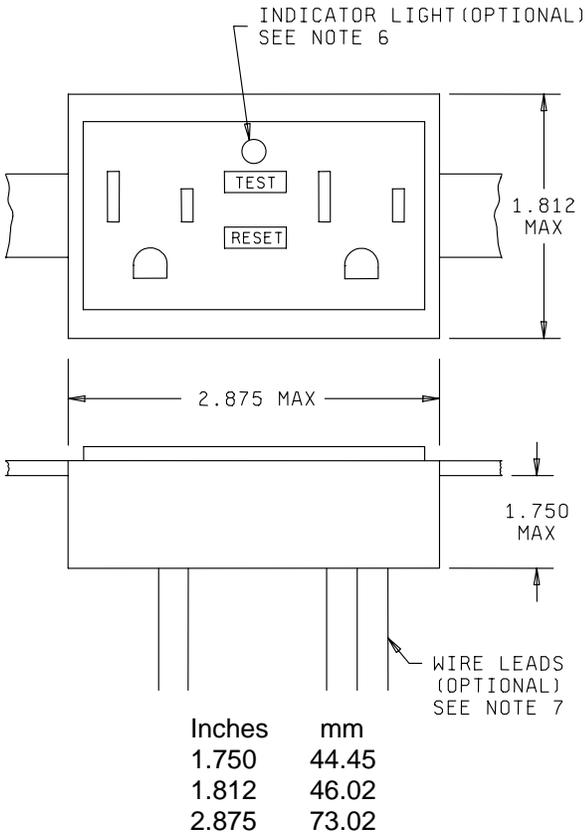


Figure 1: Configuration and dimensions.

W-C-596/212A

REQUIREMENTS:

Design and configuration: Hospital grade. See figure 1.

Dimensions: Shall conform to NEMA WD 6, configuration 5-15R.

Ratings:

- Voltage: 125 volts.
- Current: 15 amperes.
- Frequency: 60 hertz.

Mating connector: W-C-596/13.

These connectors shall meet the class A requirements as specified in UL943.

Part or Identifying Number (PIN): WC596/212- (dash number from table I).

Supersession and cross reference: See table II.

TABLE I. Dash number.

Dash no.	Description	Color
1	Hospital grade Ground fault circuit interrupting	Ivory
2	Hospital grade Ground fault circuit interrupting	Brown

TABLE II. Supersession and cross reference.

Active Government PIN	Superseded numbers			
	CAGE 1/ 74545	CAGE 75582	CAGE 04009	CAGE 71183
WC596/212-1	GF8200-I	6198-HGI		
WC596/212-2	GF8200			

1/ CAGE is the Commercial and Government Entity code which is assigned and maintained by Defense Logistics Information Service (DLIS) in Battle Creek, MI.

MILITARY INTERESTS:

Custodians:

- Army - CR
- Navy - YD
- Air Force - 11
- DLA - CC

Review Activities:

- Army - AV, CR4, MI
- Navy - AS, EC, MC, SH

CIVIL AGENCY
COORDINATING ACTIVITIES:

- DCGOVT - DCG
- DOT - ACO
- GSA - 7FXE
- HHS - FEC
- USDA - AFS

Preparing Activity:
DLA - CC

(Project 5935-4305-79)